

## Installation Instructions

### Underground Distribution System EK600 | EK800 with Swivel Cover



1	General information	4
2	Safety information	4
2.1	Electrical installation kit	4
2.2	General	5
3	Illustration of the “snorkel effect” principle	6
4	Product description	7
4.1	Technical data	7
5	Scope of delivery	8
5.1	Required tools (not included)	9
6	Installation	9
6.1	General	9
6.2	Preparing the foundation pit base	9
6.2.1	Drainage	9
6.2.2	Possible situations for the foundation pit base	10
6.3	Installation of the underground distribution system	11
6.3.1	Alignment of supply and discharge lines	11
6.4	Earthing	12
6.5	Installing the circumferential joint tape	12
7	Constructing the surrounding surface	13
7.1	Backfilling the foundation pit	13
7.2	Constructing the top layer (in the vehicle traffic area)	13
8	Preparing the swivel cover surface	14
9	Operation	14
9.1	Opening the swivel cover locking flap	14
9.2	Checking the water level	15
9.3	Opening the swivel cover locking bolt	15
9.4	Opening the swivel cover completely	16
9.5	Using the step protection cover (optional)	16
10	Operation	17
10.1	Operation when closed	17
10.2	Closing the swivel cover	17
11	Maintenance	19
11.1	General measures	19
12	Declaration of Conformity	19
13	Material defects	20
14	Quality management	20

<u>15</u>	<u>Disclaimer/Warranty</u>	<u>20</u>
<u>16</u>	<u>Contacts</u>	<u>20</u>

# 1 General information



## **Note!**

Any person involved in the assembly, connection, operation, maintenance, and repair of the product must first read, understand and follow these instructions. We accept no liability for damage and operating malfunctions caused by failure to comply with these instructions.

In the interest of further development, we reserve the right to change individual assemblies and accessories as considered necessary for further safety and performance improvements, while preserving the main features.

The copyright to these instructions remains with Langmatz GmbH.

# 2 Safety information

The product corresponds to the latest state-of-the-art technology at the time of printing and is delivered in an operationally safe condition. Unauthorised modifications, particularly to safety-related parts, are prohibited.

Langmatz GmbH warns against misuse of the product.

Before opening, ensure that the underground distribution system is not flooded.

## 2.1 Electrical installation kit

All electrical components must meet the applicable standards when installing them.

Protect electrical components from the harmful effects of water. Langmatz recommends the use of Langmatz diving-bell cabinets.

## 2.2 General

- Information signs attached to the underground distribution system must be observed.
- Information signs must be kept clean. Missing or illegible signs must be replaced.
- Regular maintenance and cleaning are essential for safe operation and must be performed by trained professionals (see also Chapter 11).

Note when folding away!



- Do not allow cables to be crushed!
- Keep folding and swivelling areas clear when folding away! **Risk of injury! Crushing of limbs.**
- Clear folding and swivelling areas of dirt and other objects.

The operating company is responsible for installing, operating and maintaining the fixtures.

### **The operating company is responsible for the following:**

- Preventing danger to the life and limb of users and third parties.
- Ensuring operational safety.
- Precluding downtime and environmental impact due to incorrect handling.
- Ensuring that protective clothing is worn when working with or on the product.
- Ensuring that users receive instructions in the proper operation of the underground distribution system.

Do not use the product if the mechanics are damaged. Please contact the hotline (see Chapter 16 Contacts).



#### **Note!**

Applicable occupational safety and environmental protection regulations must be complied with during installation, operation, maintenance, or repair.

### 3 Illustration of the “snorkel effect” principle

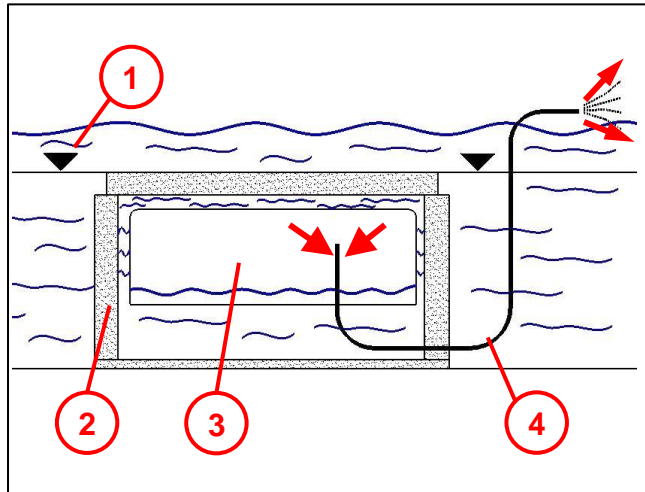


Fig. 1



**Danger!**

To prevent a “snorkel effect” in rising water, supply and discharge cables/lines **(4)** must be tightly sealed (see Fig. 2).

- 1 Ground level
- 2 Underground distribution system
- 3 Tray/flood-proof cover
- 4

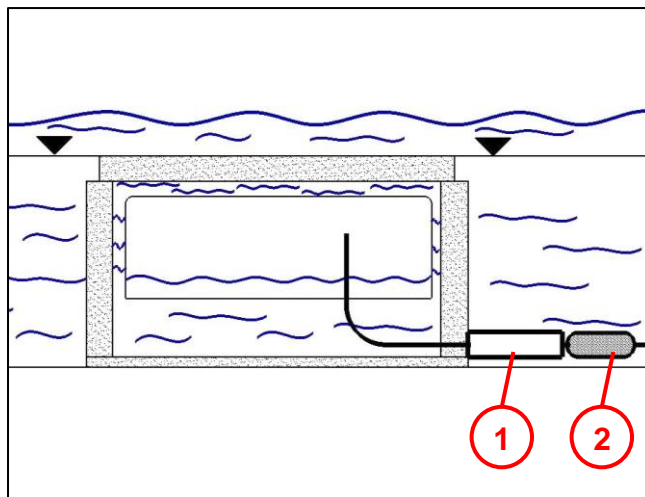


Fig. 2

The seal must be gas-tight.

- Use compression joints with an oil stop etc.
- Then encase the cable using a cast resin fibre closure **(2)**.

Fibre enclosures outside the underground distribution system:

#### **Note!**

- Do not lay cables directly in the ground!
- A conduit **(1)**, among other things, can be used to protect the cables!

## 4 Product description

The underground distribution system EK600 | EK800 has been developed primarily for energy distribution in public places and for operation by lay persons. Operation is correspondingly user-friendly and seamless. In addition, great importance is attached to safety (e.g. by means of a safety catch and step protection cover).

The power outlet distribution system is folded into the base when not in use and can, if required, be easily opened again with the aid of two gas springs. A locking system patented by Langmatz guarantees reliable opening, even if the cover is frozen shut. To prevent contamination and unauthorised access, the actuation area of the locking mechanism is equipped with a lockable flap.

All components in the cover are made from high-quality stainless steel.

Langmatz's many years of experience in the field of underground distribution systems mean that product details, such as openings for measuring the water level in the manhole and/or openings for pumping water out of the manhole, are provided as standard.

### 4.1 Technical data

	<b>EK600</b>	<b>EK800</b>
Overall external dimensions:	683 x 887 mm	825 x 1050 mm
Clear dimensions:	400 x 650 mm	550 x 800 mm
Overall depth in the ground:	640 mm; 860 mm; 1080 mm;	625 mm; 845 mm; 1065 mm;
Height with the cover folded up above ground:	810 mm	960 mm
Maximum possible cable or hose diameter:	60 mm	60 mm
Manhole cover compliant with DIN EN 124:	Load class D 400; - paveable; fillable tray depth: 65 mm;	Load class D 400; - paveable; fillable tray depth: 65 mm;
Manhole cover locking mechanism:	Yes	Yes
Manhole body material:	PC	PC
Manhole frame material:	Stainless steel 1.4301	Stainless steel 1.4301
Weight (without paving; concrete)	213 kg	238 kg

## 5 Scope of delivery

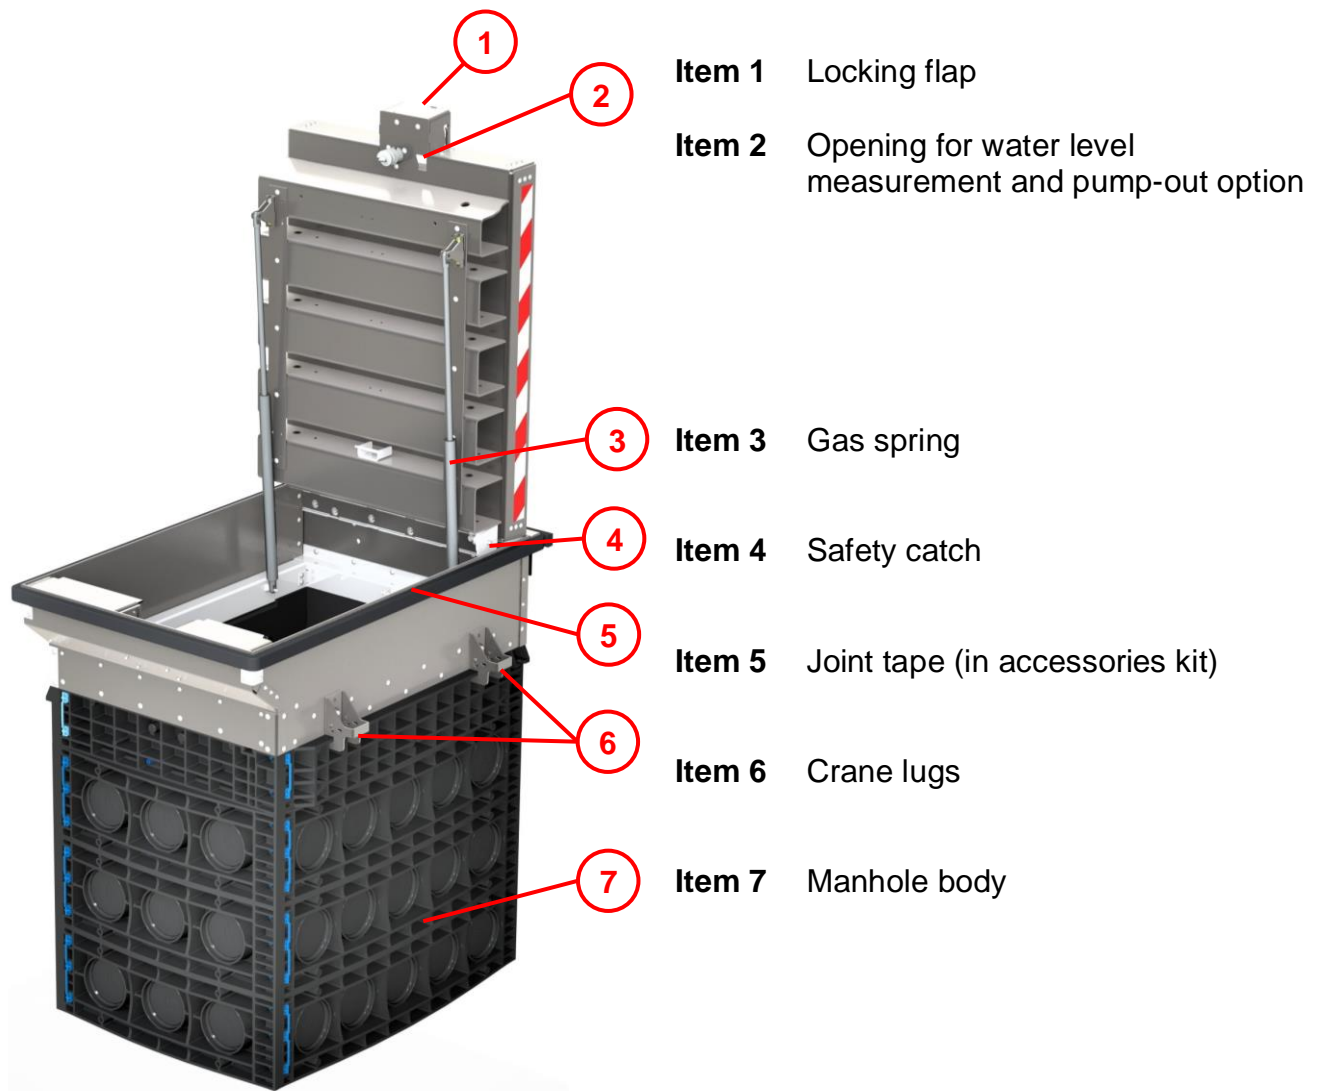


Fig. 3

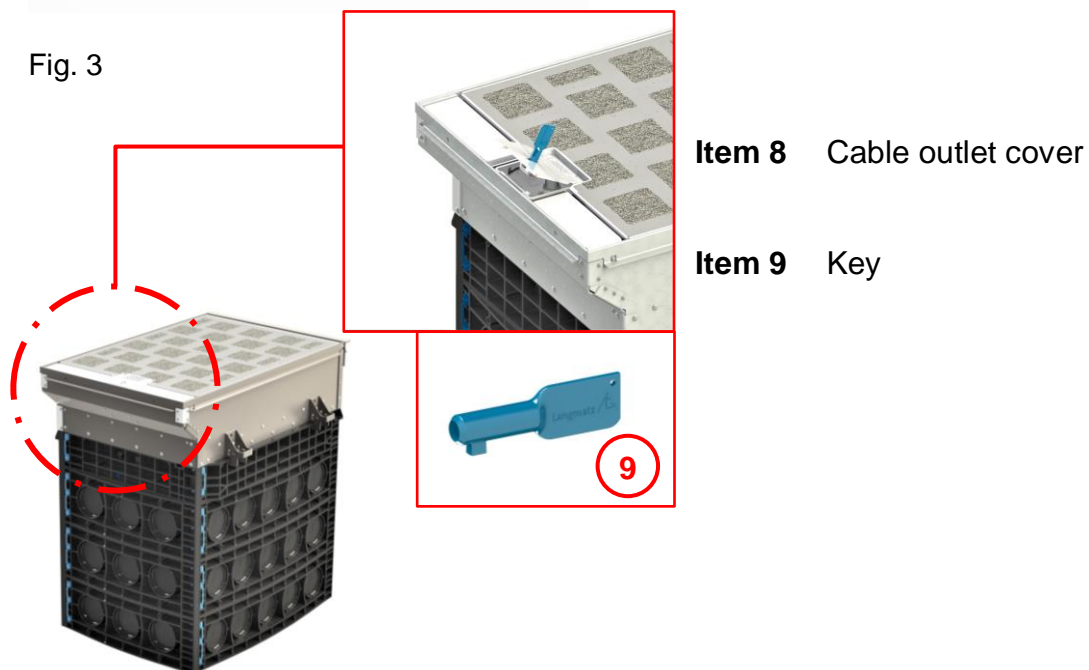


Fig. 4



## 5.1 Required tools (not included)

Commercially available tools are sufficient for installation and connection. No special tools are required.

## 6 Installation

### 6.1 General

- The underground distribution system must be installed by a qualified expert company.
- The soil conditions must be assessed before preparing a load-bearing foundation pit base.
  - The manhole must be installed in “non-cohesive” to “cohesive” mixed soils.
  - Groups G1 to G3 soil types as per ATV-DVWK-A 127 (German Association for Water, Waste Water and Waste), and/or soil groups GE, GW, GI, SE, SW, SI, GU, GT, SU, ST, GU\*, GT\*, SU\*, ST\*, UL, and UM as per DIN 18196.



#### **Caution!**

Observe ZTV A-StB 12 (Supplementary Technical Contract Conditions and Guidelines for the Construction of Asphalt Roads) for the construction of the road surface!

### 6.2 Preparing the foundation pit base

When preparing the foundation pit, comply with the following documentation from the Gütegemeinschaft Leitungstiefbau e.V. (Underground Cable Line Construction Quality Association):

*“Procedural instructions for performing tasks in underground cable line construction”.*

The position and depth of the foundation pit base must match the installation situation. The upper edge of the manhole cover must lie completely flush with the surrounding ground level and must not project.

Align the cover surface horizontally. The height cannot be adjusted with this product.

Underground distribution systems arranged next to each other must have a clearance of at least 1.00 m between them.

The supply lines must be installed by the client according to their planning specifications. The specifications in the Installation Instructions, Chapter 6.3.1 must be observed.

#### 6.2.1 Drainage

The water drainage system is connected via a predetermined breaking point in the lowest frame. The installation of a backflow trap between the water drainage connection and waste water system is recommended.

Drain any water that has penetrated into the manhole to a surface drainage system (e.g. gravel).

## 6.2.2 Possible situations for the foundation pit base

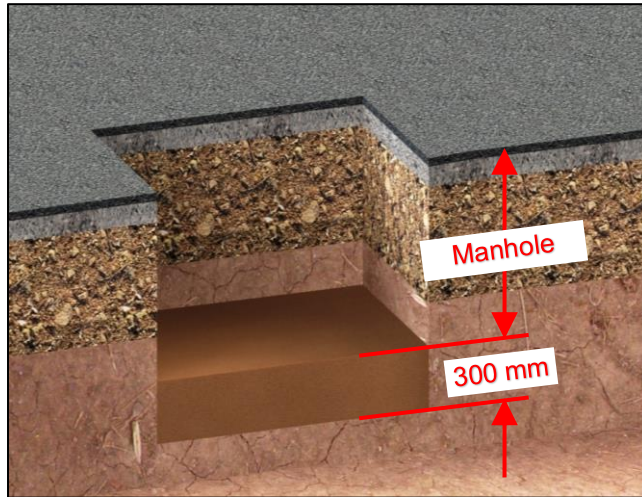


Fig. 5

### Situation A

#### For pedestrian areas:

- Use an underfill/bottom layer at least 300 mm thick.
- The underfill/bottom layer must consist of “non-cohesive” to “cohesive” mixed soil (group G1 soil type as per ATV-DVWK-A127).
- The underfill/bottom layer must be layered and compacted to  $D_{Pr} \geq 98\%$ .

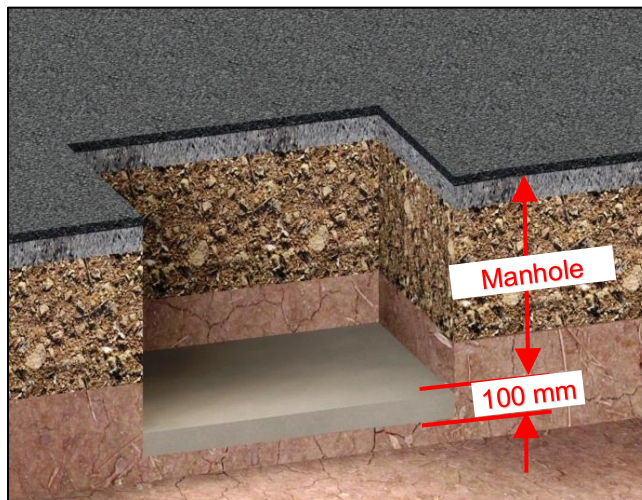


Fig. 6

### Situation B

#### For vehicle traffic areas:

- Compact the pit base according to the requirements.
- With group G1/G2 soil types as per ATV-DVWK-A 127 (soil groups GE, GW, GI, SE, SW, SI, GU, GT, SU, ST as per DIN 18196):
- Lay a concrete load-bearing layer at least 100 mm thick (tamped concrete, strength class  $\geq C8/10$ ).

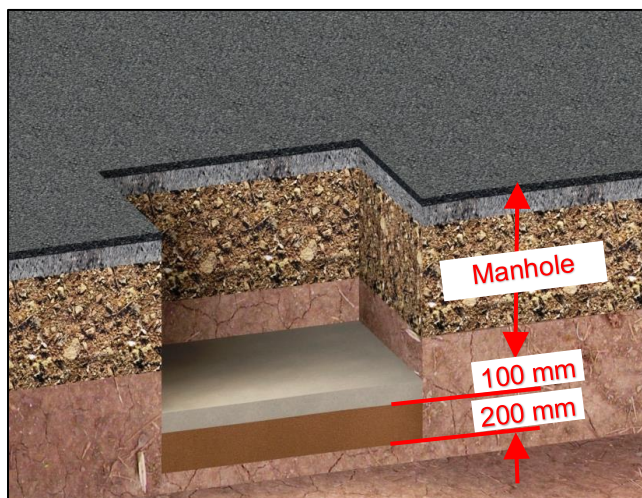


Fig. 7

### Situation C

#### For vehicle traffic areas:

- With group G3 soil type as per ATV-DVWK-A 127 (soil groups GU\*, GT\*, SU\*, ST\*, UL, UM as per DIN 18196):
- Use an underfill of group G1 soil types as per ATV-DVWK-A 127. Minimum thickness 200 mm. The underfill must be layered and compacted to  $D_{Pr} \geq 98\%$ .
- Lay a concrete load-bearing layer at least 100 mm thick (tamped concrete, strength class  $\geq C8/10$ ).



### 6.3 Installation of the underground distribution system

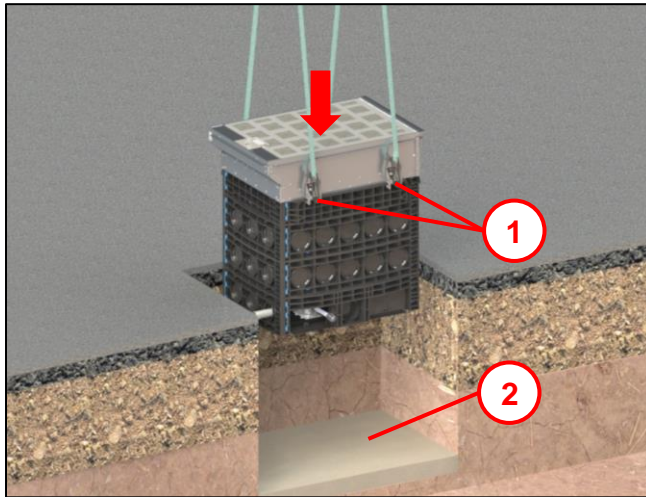


Fig. 8

- Pick up the underground distribution system using the 4 crane lugs (1) provided.
- Use suspension ropes or chains with a minimum side length of 1.0 m.
- Place the closed underground distribution system on the foundation pit base (2).

The crane lugs (1) remain secured to the underground distribution system and are buried along with it.

#### 6.3.1 Alignment of supply and discharge lines

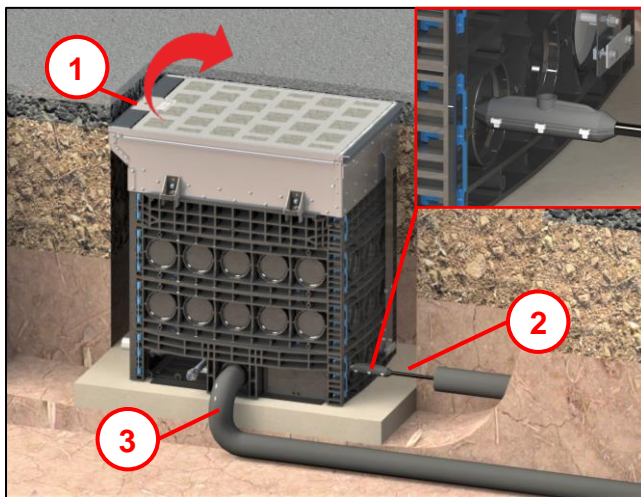


Fig. 9

#### Note!

Align the supply and discharge lines to the position of the locking flap (1)!

#### Installation showing the EK600

- Supply line (2) on the rear side opposite the locking flap (1).
- Drainage (3) – on the long side.


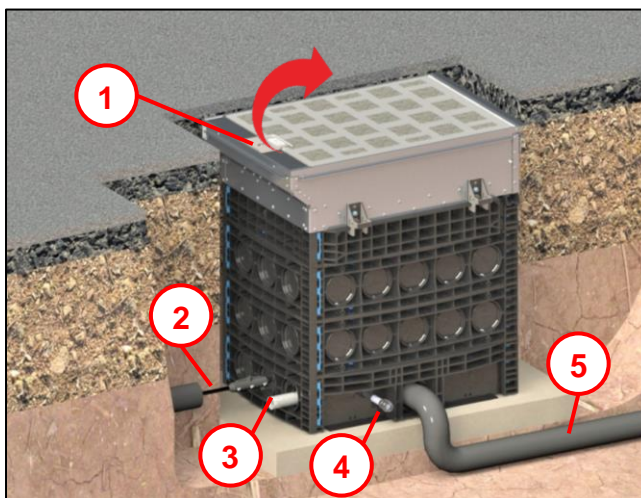


Fig. 10

#### Installation showing the EK800

- Supply line (2) on the front side below the locking flap (1).
- Waste water drain (3).
- Fresh water supply (4).
- Drainage (5) – on the long side.

## 6.4 Earthing

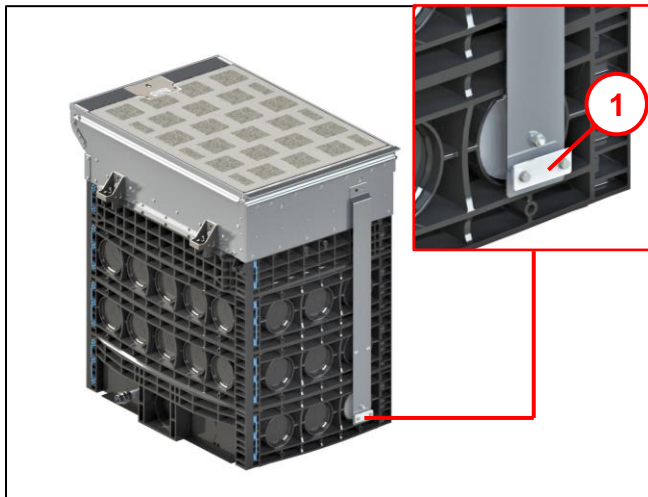

The earthing connection **(1)** is located on the rear of the underground distribution system.

It is possible to connect an earthing strip.


**Note:** The connection must be made before the foundation pit is backfilled!

Take a measurement to comply with the values specified by VDE.

Observe further specifications based on the local conditions as well as the specifications of the responsible grid operator.

Fig. 11

## 6.5 Installing the circumferential joint tape

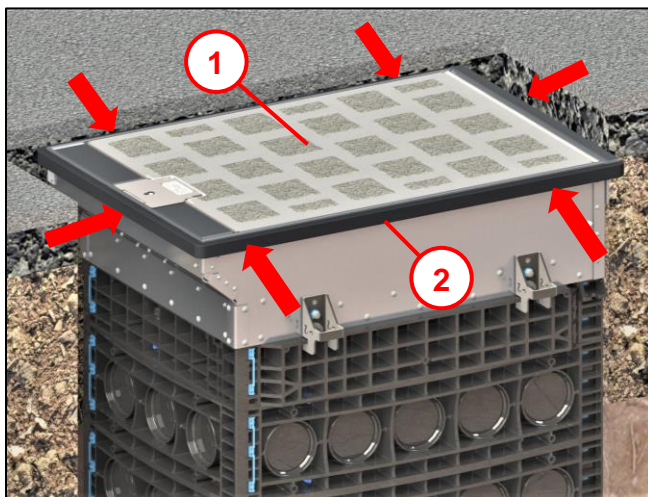


**Note:**

A joint tape **(2)** is fitted to ensure that the swivel cover **(1)** can be operated properly. This prevents the underground distribution system from being wedged or deformed.

- Attach the enclosed joint tape **(2)** right around the upper area of the steel frame as per ZTV Fug-StB01.

Fig. 12

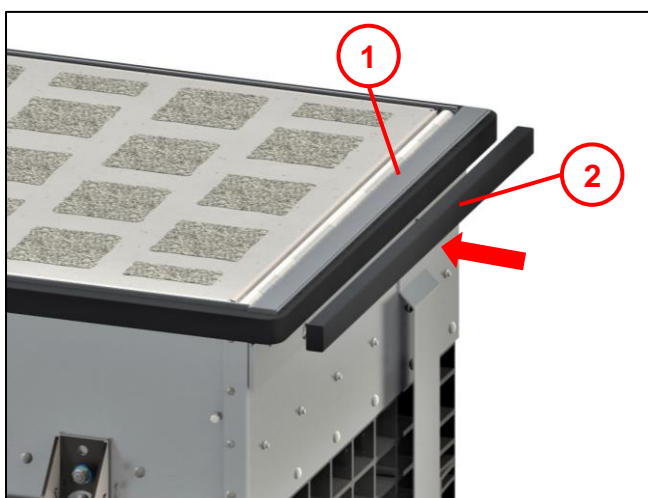

• **Important:**

Apply the joint tape **(2)** in two layers to the hinge side **(2)** of the manhole.

Fig. 13



## 7 Constructing the surrounding surface

### 7.1 Backfilling the foundation pit

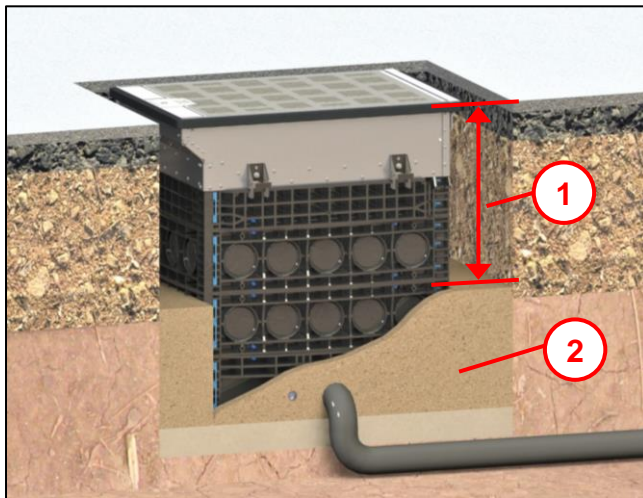


Fig. 14

- Backfill the foundation pit in layers using material suitable for compacting **(2)** in accordance with ZTV E-StB 09 up to the lower edge of the top layer **(1)**. (Top layer height approx. 65 cm).

### 7.2 Constructing the top layer (in the vehicle traffic area)

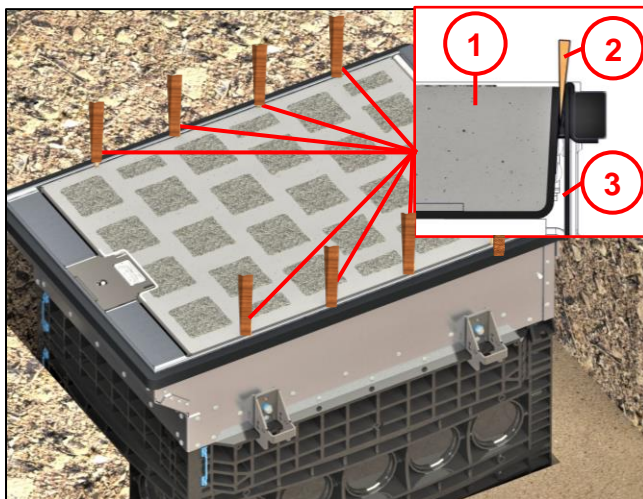


Fig. 15

#### Note!

Before compacting the top layer, make sure that the gap between the swivel cover **(1)** and the steel frame **(3)** is secured to prevent deformation (warping)!

- Drive in the 8 enclosed wooden wedges **(2)** between the swivel cover **(1)** and the steel frame **(3)**.

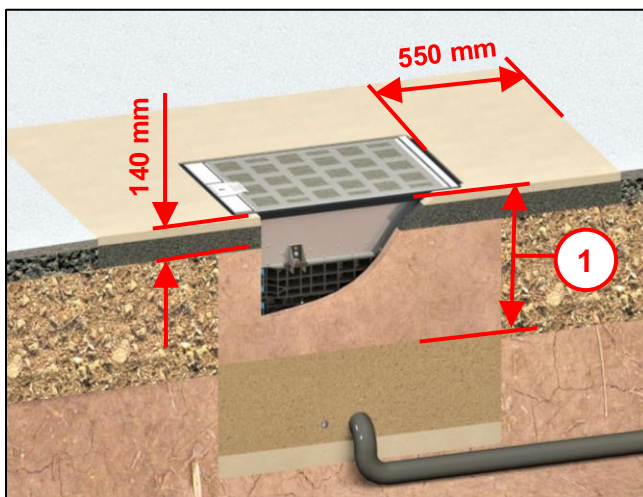


Fig. 16

- Construct the top layer **(1)** as per ZTV A-StB 12 (and/or RStO 2001). In the vehicle traffic area: At the upper edge of the top layer, there must be a strip of concrete or poured asphalt at least 550 mm wide and 140 mm thick (asphalt base layer of at least construction class V according to RStO 2001 (Guidelines for the standardisation of traffic area top layers)).

## 8 Preparing the swivel cover surface

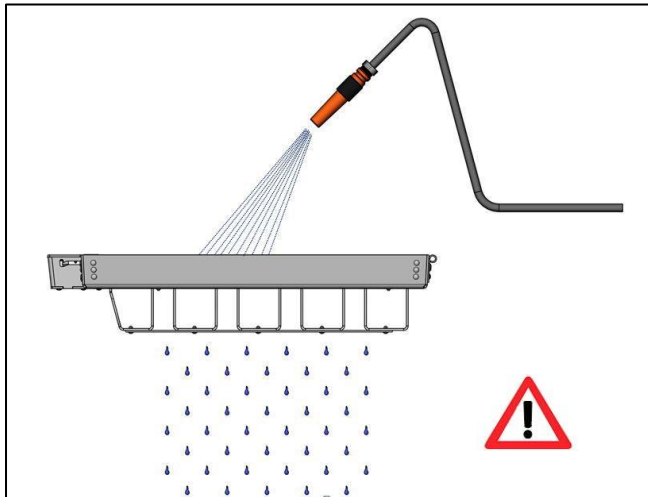


Fig. 17

### **Warning!**

The swivel cover is not sealed at the factory!

- The swivel cover surface is delivered empty from the factory and can therefore be paved.
- **If the swivel cover surface is constructed by the client, please note:**  
The covering installed may not become loose or fall out when the swivel cover is open. Therefore, secure it well!

## 9 Operation

### 9.1 Opening the swivel cover locking flap

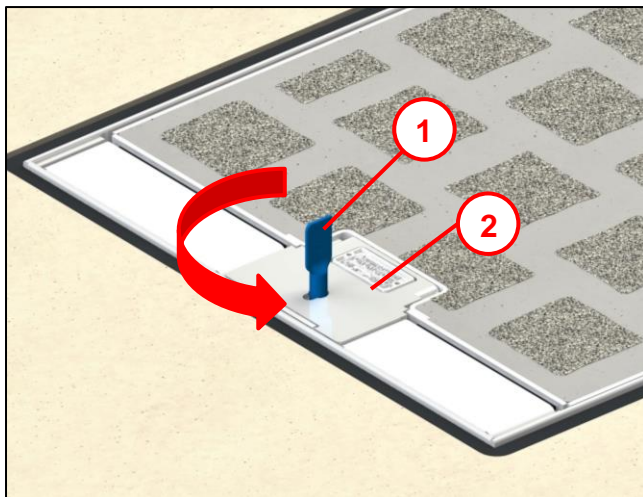


Fig. 18

### **Caution!**

When opening, exit the swivelling area / danger area and ensure that it is free of objects.

- Unlock the locking flap (2) with the enclosed key (1) (anticlockwise).

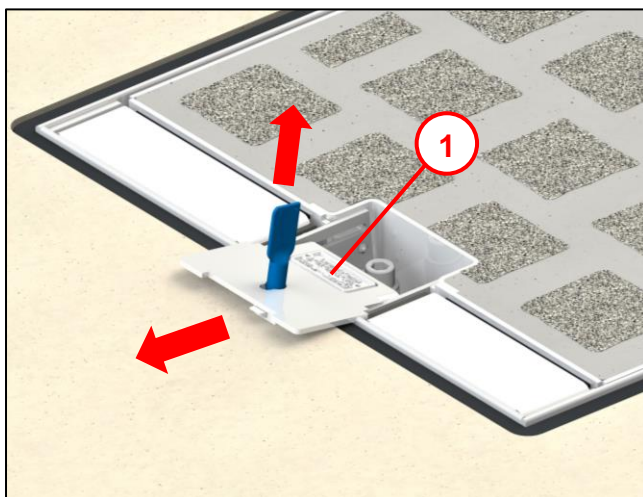


Fig. 19

- Fold the locking flap (1) upwards and pull it forwards.



## 9.2 Checking the water level

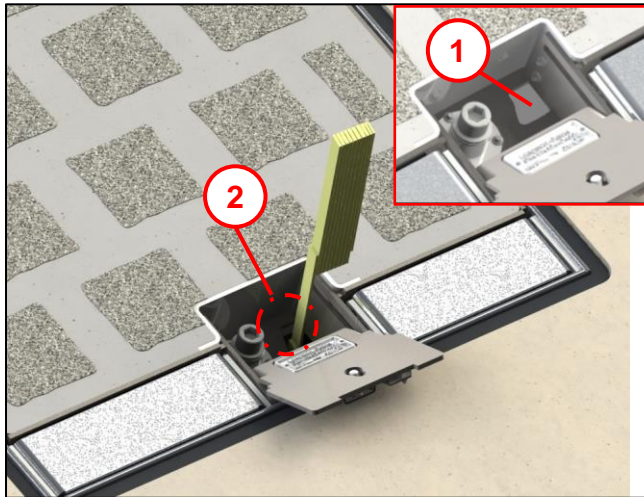


Fig. 20

Opening to check the water level, e.g. in the event of flooding **(1)**.

Doubles as a pump-out opening.

- Insert a metre rule (or other suitable tool) into the opening down to the bottom **(2)**.
- Do not open if there is water standing!
- Pump out the underground distribution system through the opening.

## 9.3 Opening the swivel cover locking bolt

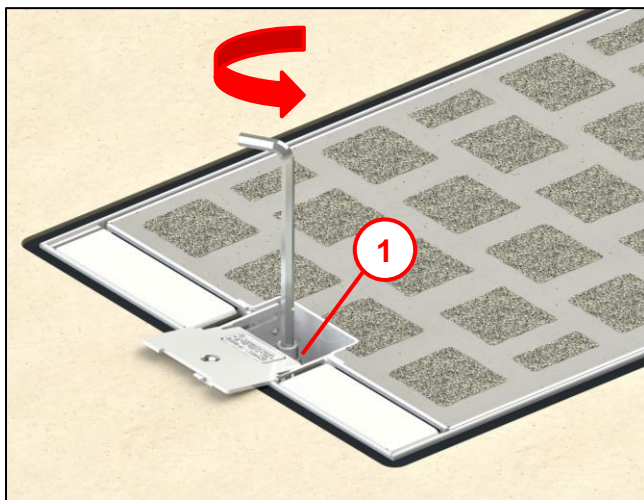


Fig. 21

- Insert the enclosed hexagon socket spanner, AF14, into the locking bolt **(1)**.
- Turn the hexagon socket spanner anticlockwise.
- The swivel cover raises by a few centimetres.
- Turn the locking bolt further until the swivel cover disengages from the locking system.
- This state is reached once the turning movements no longer produce any noticeable resistance.

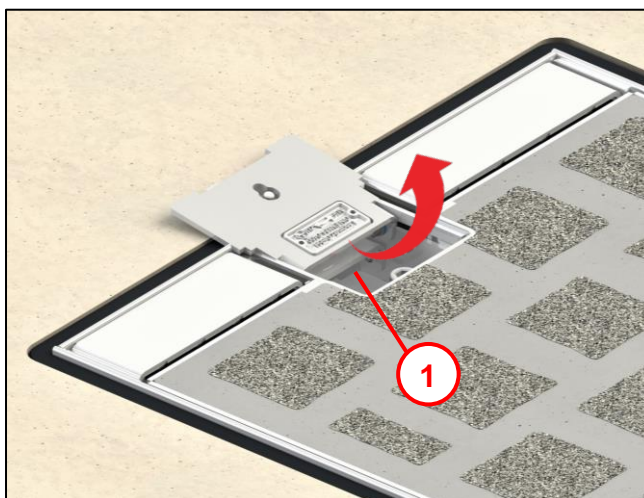


Fig. 22

- Tighten the swivel cover using the handle recess **(1)**.
- The swivel cover folds upwards with support by the gas springs (in the interior).

### **Note:**

The gas springs serve as an opening aid. Temperature fluctuations affect the sliding properties of the gas springs.

## 9.4 Opening the swivel cover completely

(Illustration showing removal and step protection cover)

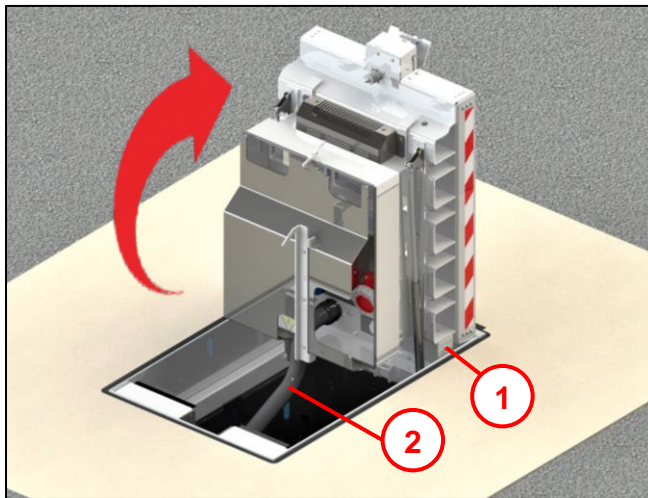


Fig. 23

- Open the swivel cover until the safety catch (1) on the side engages.



### Warning!

Check the supply cable (2) for any damage. Do not operate the underground distribution system if the supply cable is damaged. Risk due to electric shock and fire hazard!

## 9.5 Using the step protection cover (optional)

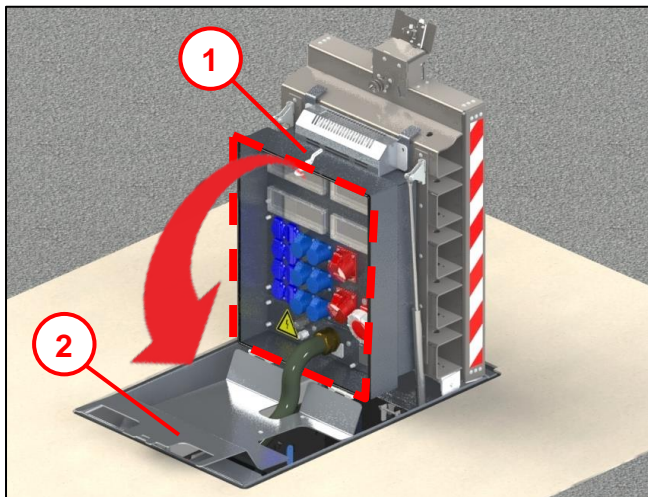


Fig. 24

The underground distribution system is shown here with a step protection cover (2) (optional).

- After the swivel cover has been opened, loosen the locking hook (1) and fold down the step protection cover.



### Caution!

When operating open, always fold down the step protection cover (2) (risk of falling/injury)!



## 10 Operation

### 10.1 Operation when closed

(Illustration showing removal and step protection cover)

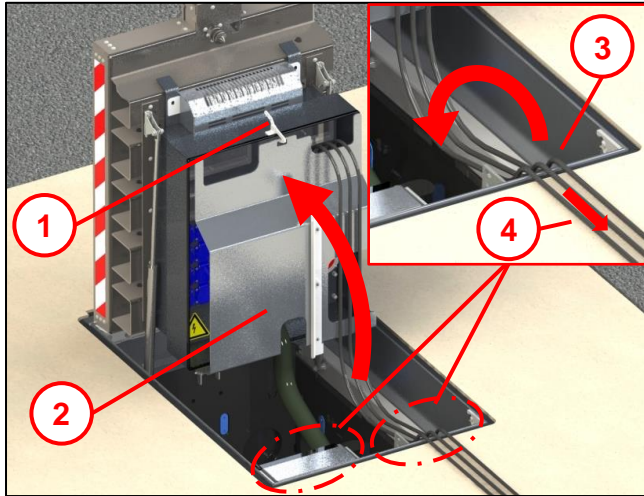


Fig. 25

#### Note!

Before closing the swivel cover, open the required cable outlet cover (3) as follows.

- Fold up the step protection cover (2) (optional).
- Close the locking hook (1).
- Lift the required cable outlet cover (3) and pull it down in the guide slot.
- Route cables and hoses (4) through the respective cable outlet opening.
- Make sure that the cables/hoses are not pinched or crushed.

### 10.2 Closing the swivel cover

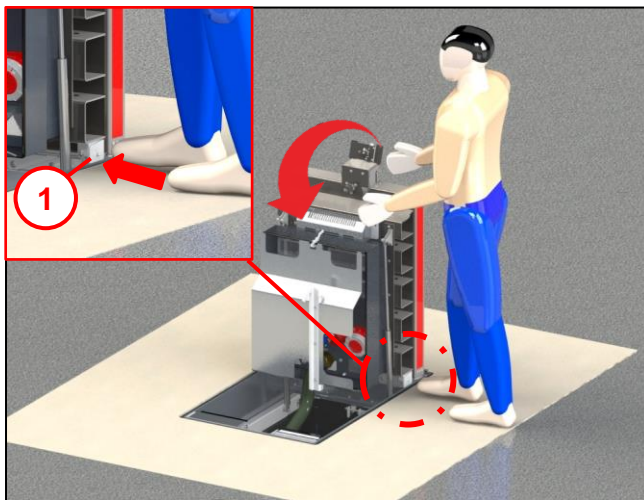


Fig. 26

- The swivel cover is unlocked by pressing the safety catch (1) with your foot.

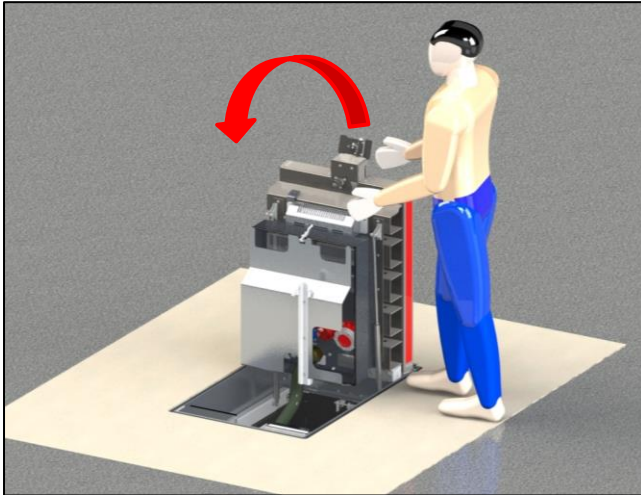


Fig. 27

- Swing in the swivel cover with pressure downwards.
- The gas springs dampen and prevent it from falling shut.



**Caution!**

Ensure that the cables/hoses are routed tidily.

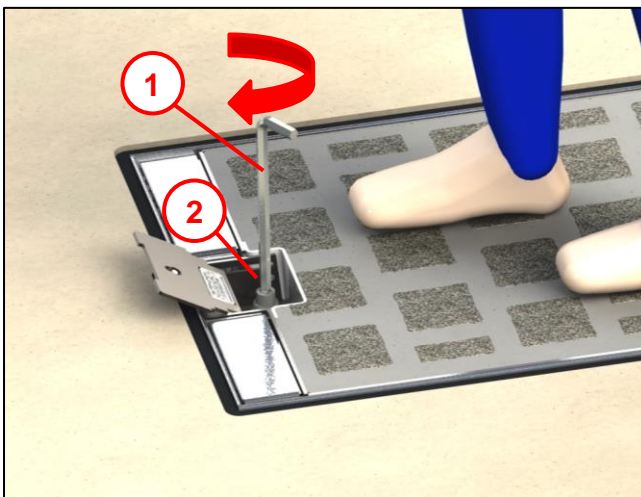


Fig. 28

- The user should stand on the swivel cover to lock the underground distribution system.
- Insert the hexagon socket spanner, AF 14 (1), into the locking bolt (2).
- Turn clockwise and lock the swivel cover.
- Turn until the swivel cover has lowered to the level of the steel frame and a noticeable resistance can be felt when turning.

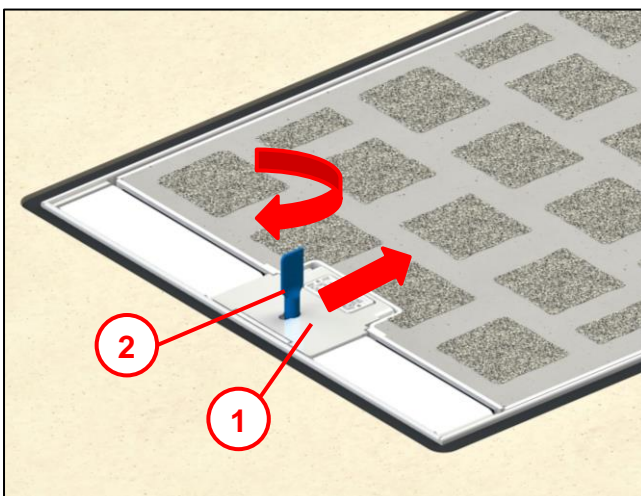


Fig. 29

- Push back the locking flap (1) and lock it with the enclosed key (2) (clockwise).

## 11 Maintenance

### 11.1 General measures

Measures	Intervals	Remarks
Clean the interior of underground distribution system	After every use	(By trained professionals)
Check that the fastening screws fit securely	Annually	
Open and close the swivel cover	Every six months	Regularly operate the gas springs to lubricate the seals.
Visual inspection of the drain for free drainage	After every use	

## 12 Declaration of Conformity

The product meets the requirements of the following applicable harmonisation directives:

**2006/42/EC**              Machinery Directive

Compliance with the relevant harmonisation legislation has been demonstrated through the application of the following harmonised standards:

**No applicable harmonised standards exist.**

Compliance with the harmonisation legislation has been demonstrated through the application of the following other standards and technical specifications:

**DIN EN 124-1: 2015-09 (not harmonised)**

**DIN EN 124-3: 2015-09 (not harmonised)**

## 13 Material defects

Langmatz accepts liability for material defects in the product as per Section 434 BGB (German Civil Code) for 24 months, starting from the date on the purchase receipt.

Within the scope of liability, all parts that become damaged due to manufacturing faults or material defects will be replaced or repaired free of charge.

The purchaser must report any deficiency complaints immediately in writing.

Claims by the purchaser for damages due to material defects or for whatever legal reason will not be accepted.

Any damage or failure caused by the following are also excluded from liability

- Incorrect use,
- Natural wear and tear
- Intervention by third parties.

We accept no liability for damage caused by force majeure or transport.

Repairs due to a deficiency complaint do not extend the warranty period for the replaced parts or the product.

This product conforms to the latest state-of-the-art technology. Nevertheless, if you experience any problems with it, please contact our hotline (see section 16 Contacts).

## 14 Quality management

The Langmatz GmbH quality management system is certified to DIN EN ISO 9001.

## 15 Disclaimer/Warranty

The information in this technical document is presented appropriately and correctly in compliance with the technical regulations, and to the best of our knowledge.

However, this does not confer any guarantee of particular characteristics. In this context, the company that operates the products supplied by Langmatz GmbH is expressly obliged to decide, based on its own judgement, whether the products are suitable and appropriate for the application or use being considered. The product liability accepted by Langmatz GmbH relates exclusively to our conditions of sale, delivery, and payment. Langmatz GmbH accepts no liability on the basis of random, indirect and resultant consequential damage, or of any damage attributable to any use of the product other than its intended purpose as described.

## 16 Contacts

Langmatz GmbH | Am Gschwend 10  
82467 Garmisch-Partenkirchen, Germany

Our hotline: +49 88 21 920 – 137

Phone: +49 88 21 920 – 0

E-mail: [info@langmatz.de](mailto:info@langmatz.de) | [www.langmatz.de](http://www.langmatz.de)

